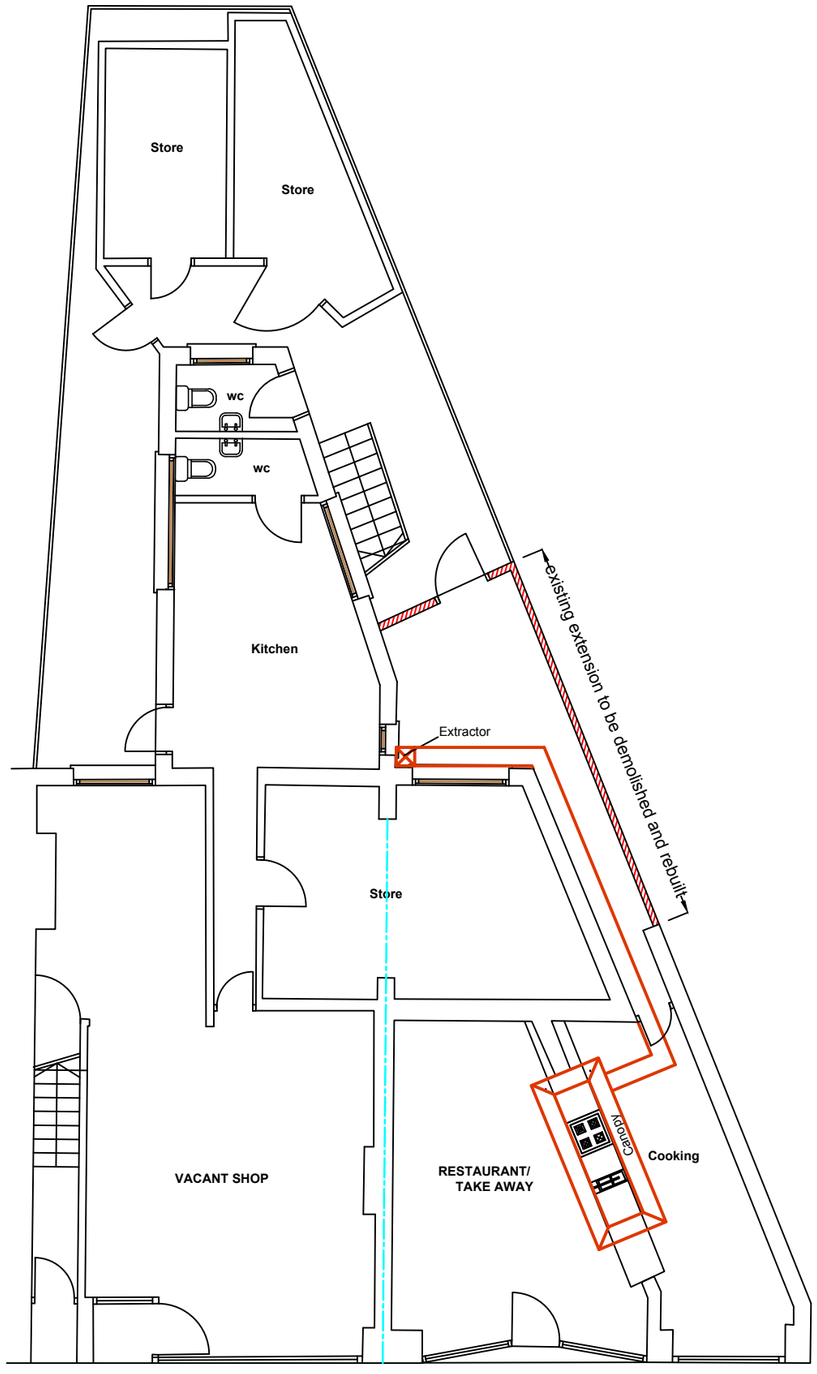

EXISTING GROUND FLOOR PLAN

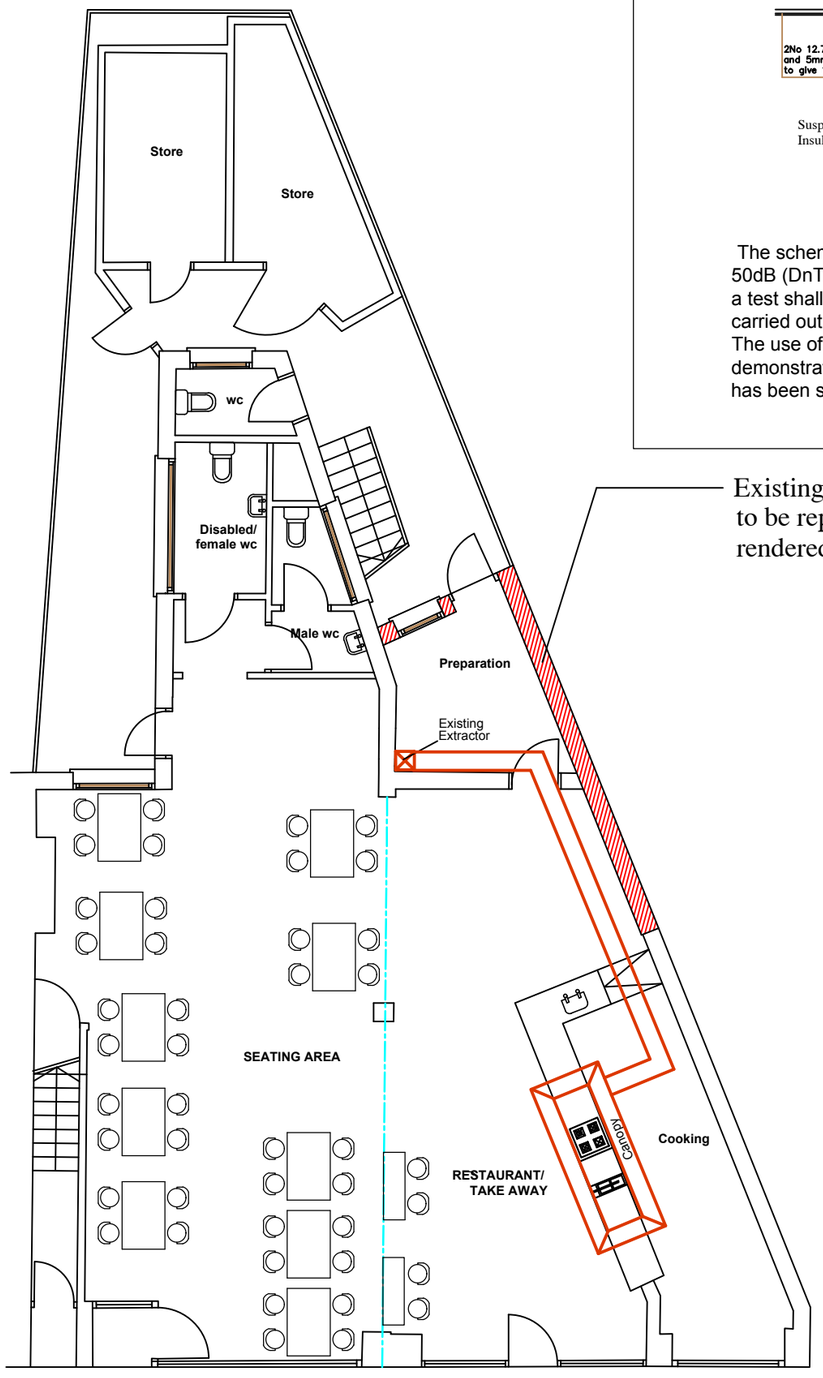

PROPOSED GROUND FLOOR PLAN

Sound and Fire Insulation Detail
TO BE CONDITIONED

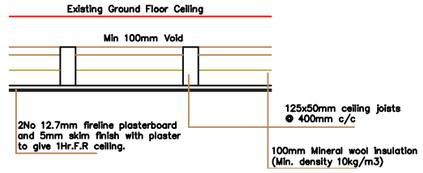

Suspended Ceiling : Sound & Fire
Insulation Detail To Ground Floor Ceiling

The scheme shall achieve a minimum airborne sound insulation value of 50dB (DnTw + Ctr dB). Following implementation of the insulation scheme, a test shall be undertaken to demonstrate that the attenuation measures carried out has achieved the minimum airborne sound insulation criteria. The use of the development shall not commence until test results, demonstrating the minimum sound insulation criteria has been achieved, has been submitted to and approved by the local planning authority

Existing Extension
to be replaced
rendered walls to match existing



Notes:

1. All dimensions in millimetres (mm) and levels in metres (m) unless noted otherwise.
2. This drawing to be read in conjunction with all other relevant drawings and specification.
3. All work to comply with the relevant British Standards, Codes of Practice and the Building Regulations.

* PLANS ARE STRICTLY SUBJECT TO BUILDING CONTROL AND OTHER LOCAL AUTHORITIES APPROVAL
*ANY WORKS CARRIED OUT PRIOR TO APPROVALS ARE AT OWNERS/CONTRACTORS' OWN RISKS

Project:

8-12 South Street,
Lancing, BN15 8AG

Revisions:

Drawing Title:

Existing and Proposed
Floor Plans

Drawing No:	Revision:
040320/PP/02	B
Scale: 1/100@A3	Date: February 2020

NArch London
Hamilton House, 4th Floor,
Mabledon Place, King's Croos
London WC1H 9BB

020 8889 0468
074 0016 6788
www.narch.co.uk