


Tree Protection Method Statement – 42 Mill Road

The following requirements are made to ensure that all trees identified for retention survive all construction operations.

British Standards 5837:2012 recommends that the RPAs of the subject trees should be protected by the erection of barriers, the preferred form of which consists of welded mesh 'Heras' type panels 1.8 metres high, mounted on a braced scaffolding frame as detailed in Figure 2 & 3 of BS 5837:2012.

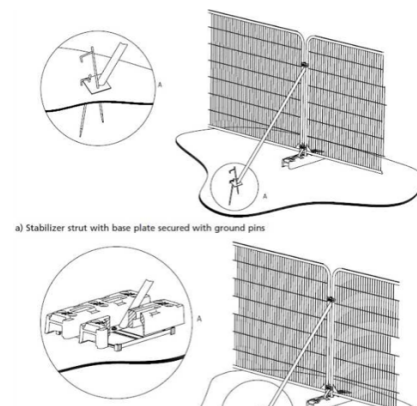

The barriers need to carry laminated signs or similar stating: "Construction exclusion zone – No Access," or similar. Gaps are required to be left beneath the bottom of any perimeter site fencing and the ground to allow free movement of any mammals.



No specific information has been provided to enable an assessment of the potential impact of above and below ground utilities and services. It is reasonably assumed, however, that no above ground and/or below ground services will be routed within the root protection areas of trees to be retained.