



www.dryrisersdirect.co.uk

Dry Risers Direct Limited
Units 2 & 3 Millbank House, Riverside Business Park, Wilmslow,
Cheshire, England, SK9 1BJ

Phone: 0800 689 4034
Email: Enquiries@dryrisersdirect.co.uk
Company Reg. No. : 09821928
UTR No. : 5932 830000

Service Type

Flow and Pressure Test

Job ID

46366

Date of Service

11/02/2026

Site Address

The Lodge

Customer Name

Marmont Developments


Engineer Name

Alan

Hydrant Location

Hydrant Location	Flow (LPM)	Pressure (Bar)	Pit (< 300mm)	Frame	Lid	Signage	Comments
Side of house in the garden rockery	334.16	9.5	Good	Good	Needs Paint	Good	Pressure ok , Flow fail on 334 might need investigation of ring main on isolation valves being fully opened, lid cover needs painting, and new H plate

Attachments

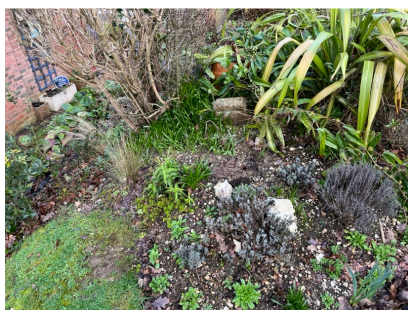



www.dryrisersdirect.co.uk

Dry Risers Direct Limited
Units 2 & 3 Millbank House, Riverside Business Park, Wilmslow,
Cheshire, England, SK9 1BJ

Phone: 0800 689 4034
Email: Enquiries@dryrisersdirect.co.uk
Company Reg. No. : 09821928
UTR No. : 5932 830000



Engineer Name

Alan

Engineers Signature

A black rectangular box covering the engineer's signature.

Site Contact Name

Customer Signature

