


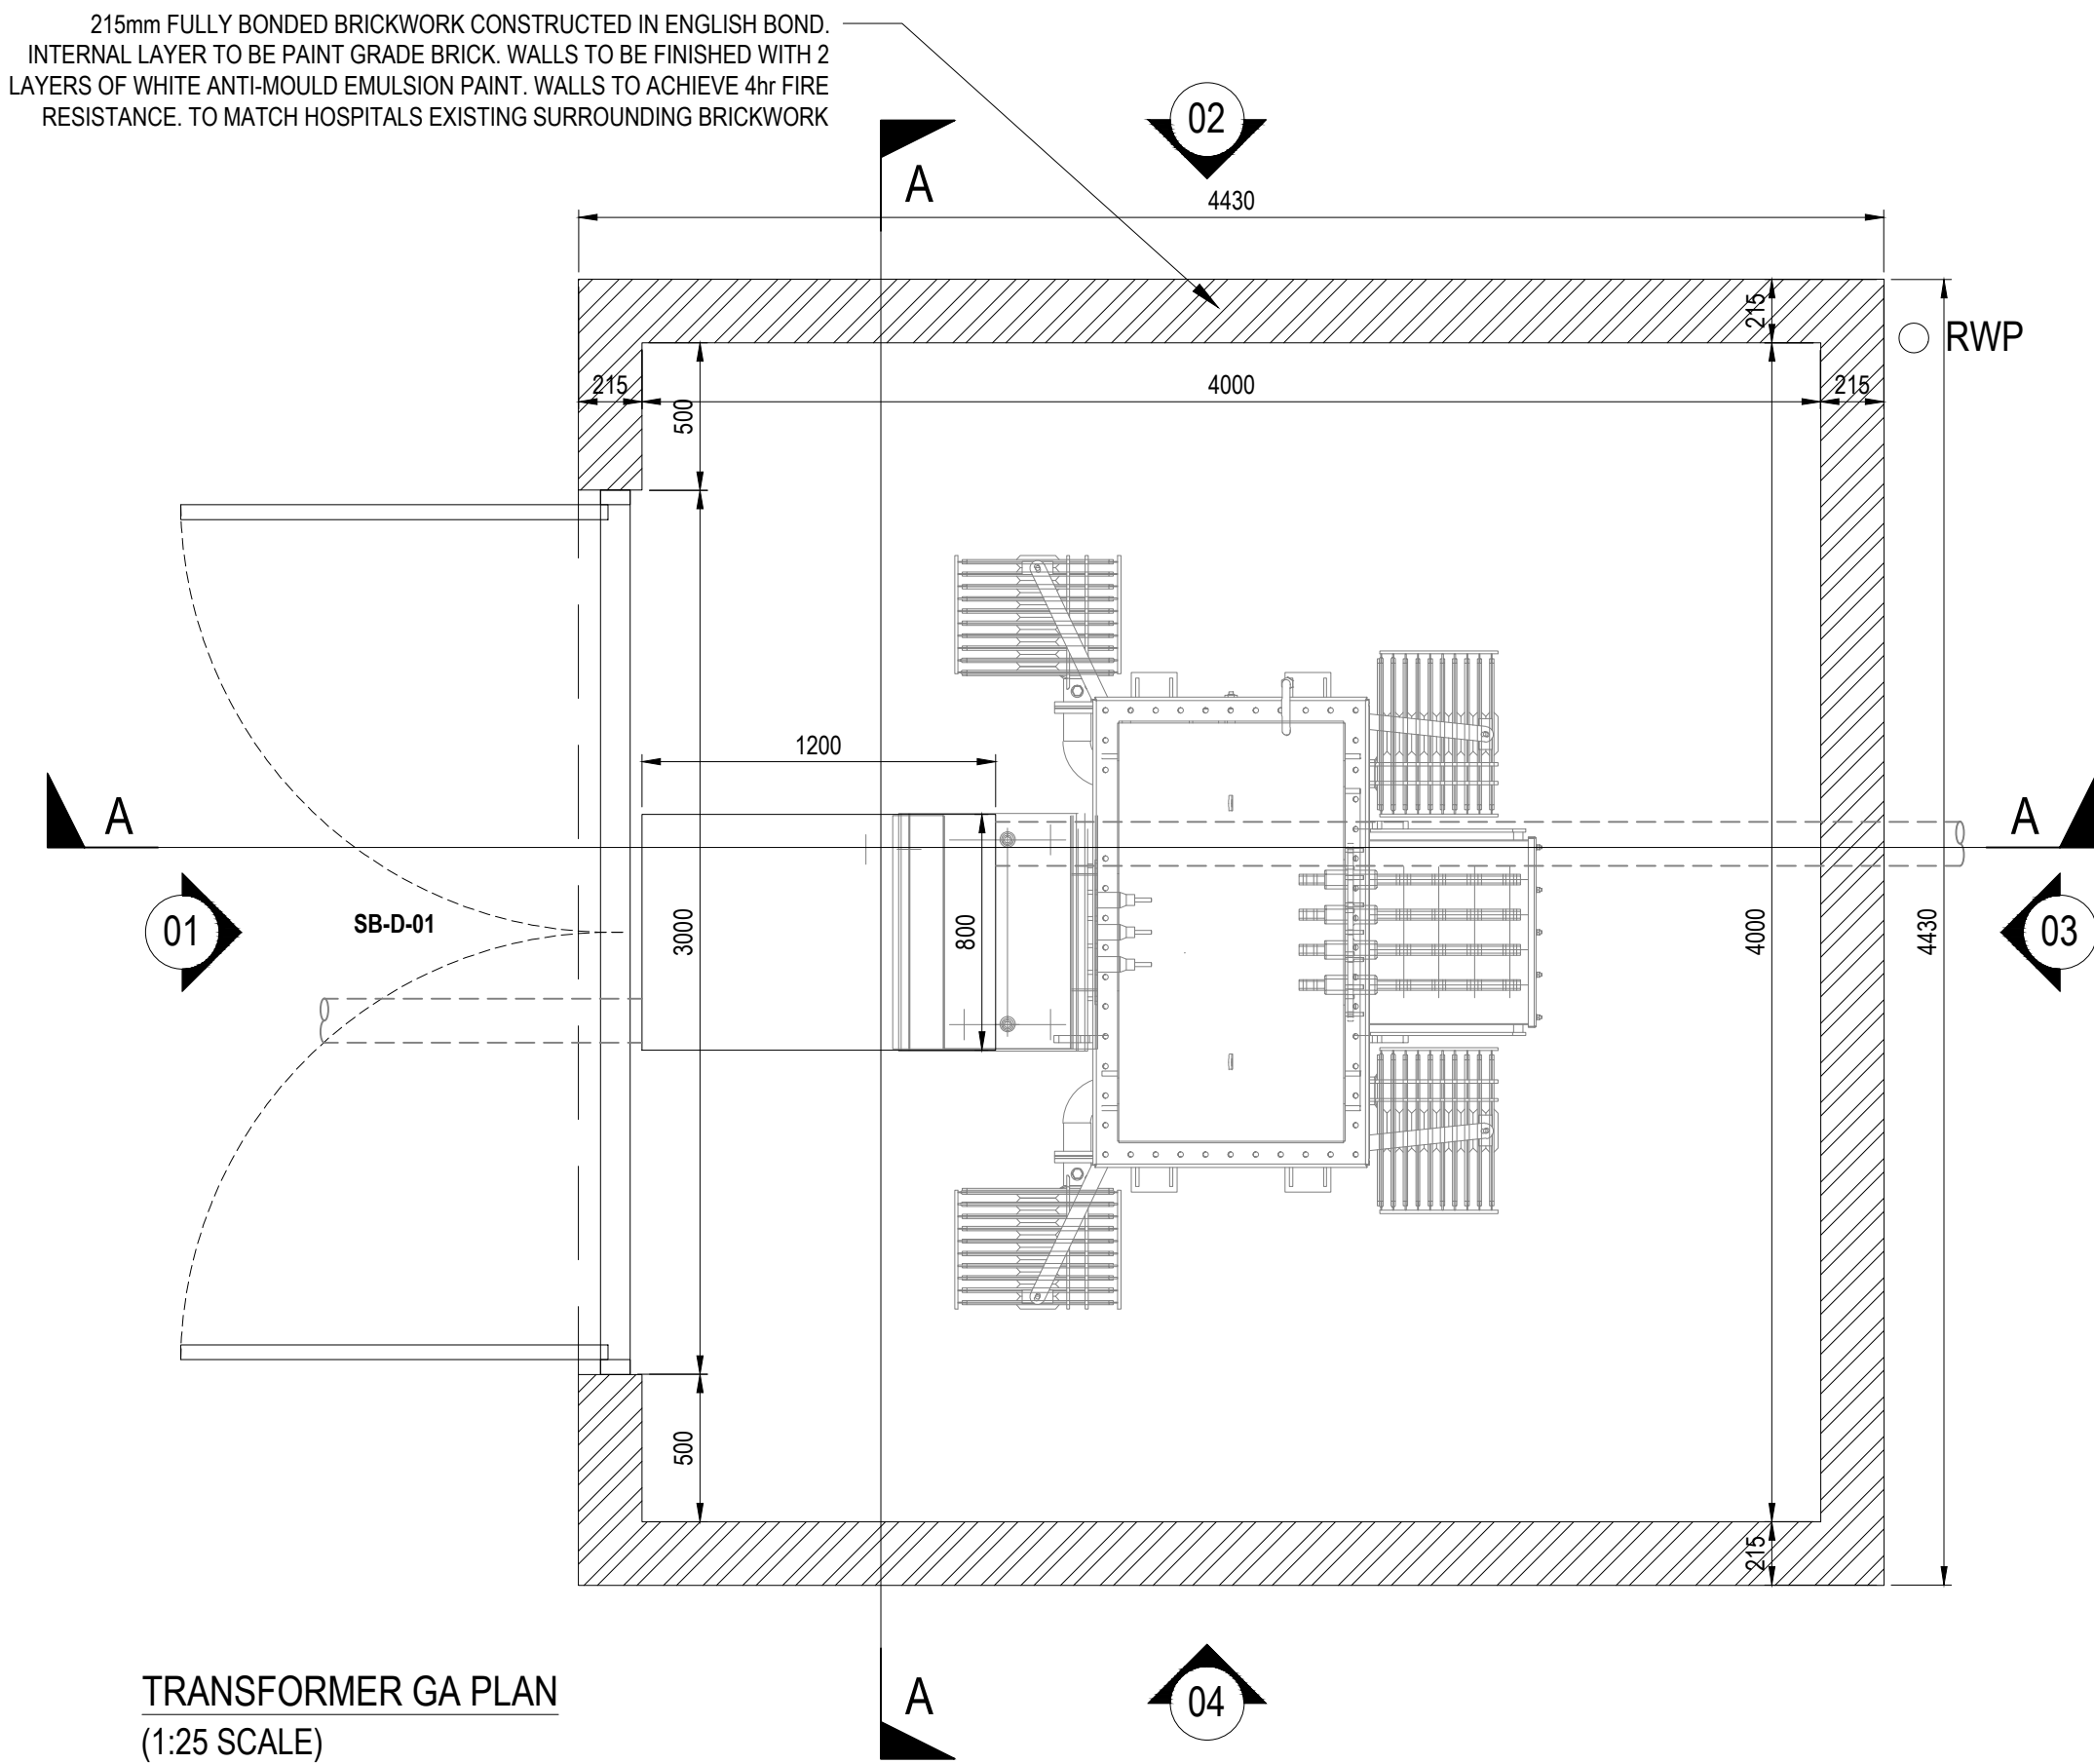

GENERAL NOTES:

ALL BUILDERS WORK IS TO BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENT AND RELEVANT BUILDING REGULATIONS AND BRITISH STANDARDS. MANUFACTURERS INSTALLATION/ GUIDANCE NOTES ARE TO BE READ IN CONJUNCTION TO TASK BEING CARRIED OUT.

ALL DIMENSIONS ON DRAWING ARE IN MILLIMETERS UNLESS OTHERWISE STATED. ALL LEVELS ON DRAWING ARE IN METERS UNLESS OTHERWISE STATED.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE ACCURACY OF ALL DIMENSIONS AND FOR THE CORRECT SETTING OUT OF WORK CARRIED OUT ON SITE.

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL, STRUCTURAL AND MECHANICAL DRAWINGS/ SPECIFICATIONS ISSUED.

ALL MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE RELEVANT SPECIFICATIONS AND BRITISH STANDARDS

THE CONTRACTOR SHALL ENSURE THE STABILITY OF THE BUILDING AND ANY ADJOINING STRUCTURES IS MAINTAINED AT ALL STAGES OF CONSTRUCTION. THE CONTRACTOR SHALL DESIGN, INSTALL AND MAINTAIN ANY NECESSARY TEMPORARY WORKS.



CONTRACTOR TO PROVIDE METHOD STATEMENTS AND RISK ASSESSMENTS TO THE ENGINEER AND PLANNING SUPERVISOR A MINIMUM OF 14 DAYS BEFORE THE WORKS COMMENCE

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH:

50857-VE-SW-00-DR-A-5003 Proposed Site Plan
50857-VE-SW-XX-DR-A-5006 Site Layout Services Overlay
50857-VE-SW-XX-E-A-6001 Transformer GA Plans and Elevations
50857-VE-SW-XX-E-A-5001 Existing and Proposed Elevations 01
50857-VE-SW-XX-E-A-5002 Existing and Proposed Elevations 02


STEEL POWDER COATED DOUBLE LEAF ACCESS DOORS WITH 4no. 1100mm x 500mm VENTILATION LOUVRES. COLOUR TO MATCH EXISTING HOSPITAL VENTILATION LOUVRES. CONTRACTOR TO PROVIDE SAMPLES BEFORE INSTALLATION

215mm FULLY BONDED BRICKWORK CONSTRUCTED IN ENGLISH BOND. INTERNAL LAYER TO BE PAINT GRADE BRICK. WALLS TO BE FINISHED WITH 2 LAYERS OF WHITE ANTI-MOULD EMULSION PAINT. WALLS TO ACHIEVE 4hr FIRE RESISTANCE. TO MATCH HOSPITALS EXISTING SURROUNDING BRICKWORK

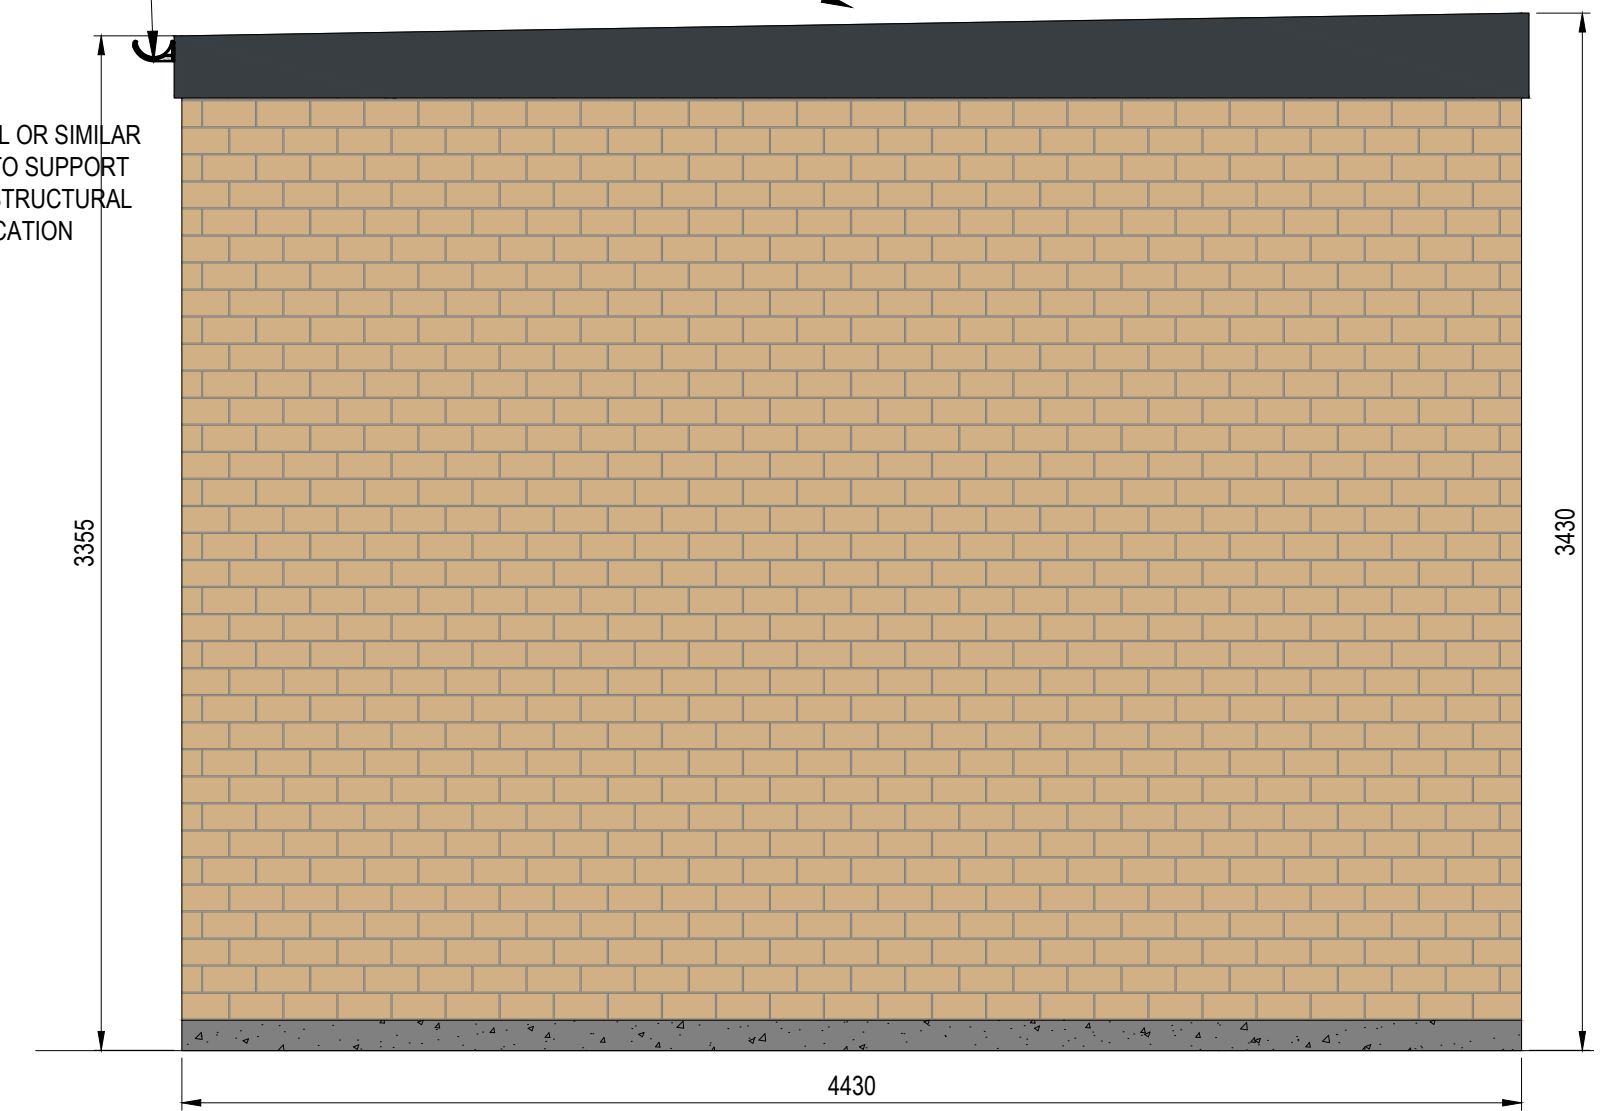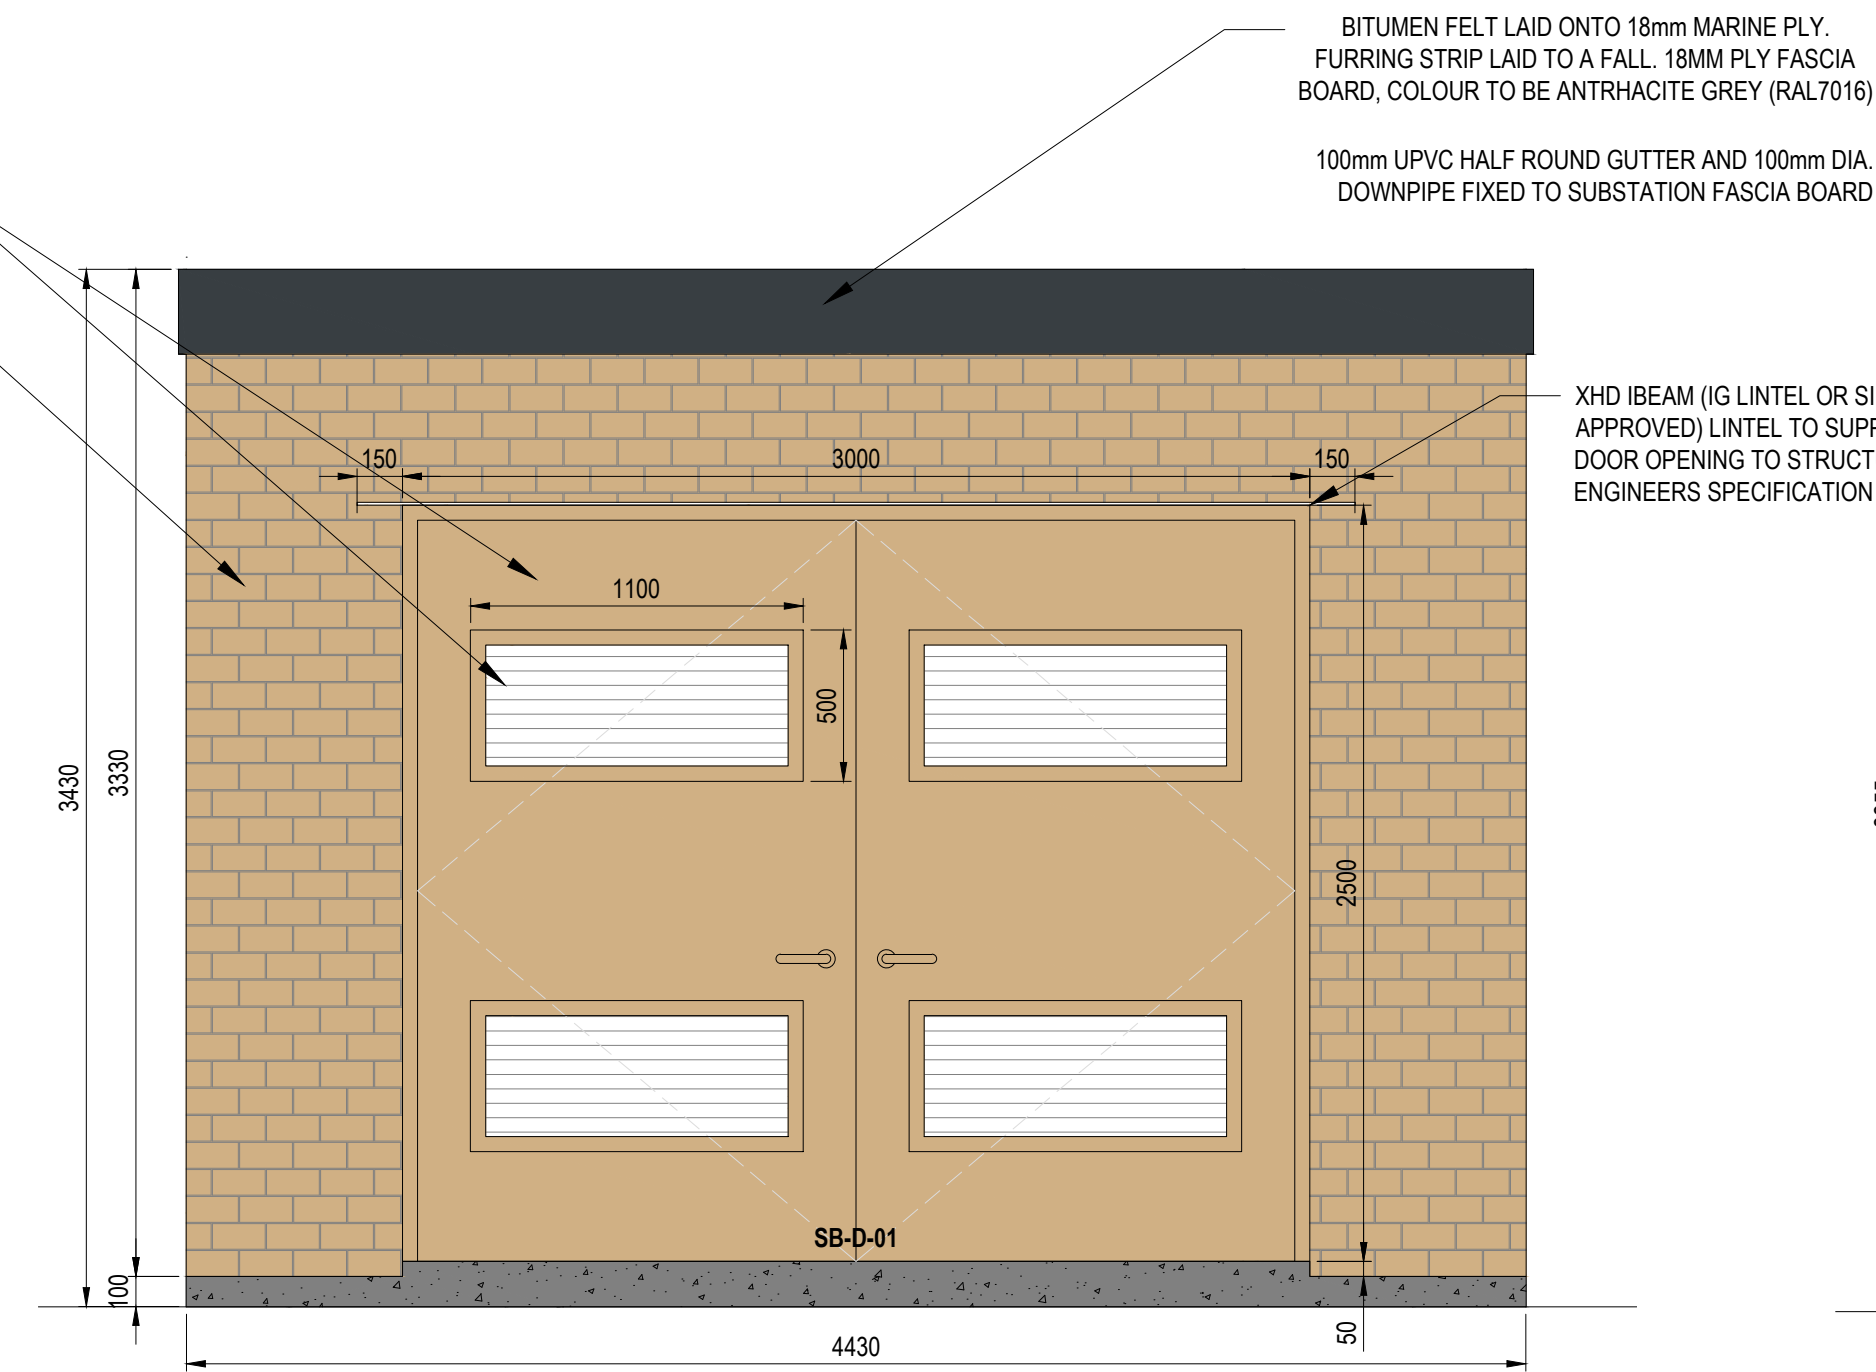



1no. 2000mm WIDE x 1000mm HIGH VENTILATION LOUVRE WITH ANTI-VERMIN MESH TO REAR, LOUVRE TO ACHIEVE MINIMUM 2m² AREA

100mm UPVC HALF ROUND GUTTER AND 100mm DIA. DOWNPIPE FIXED TO SUBSTATION FASCIA BOARD

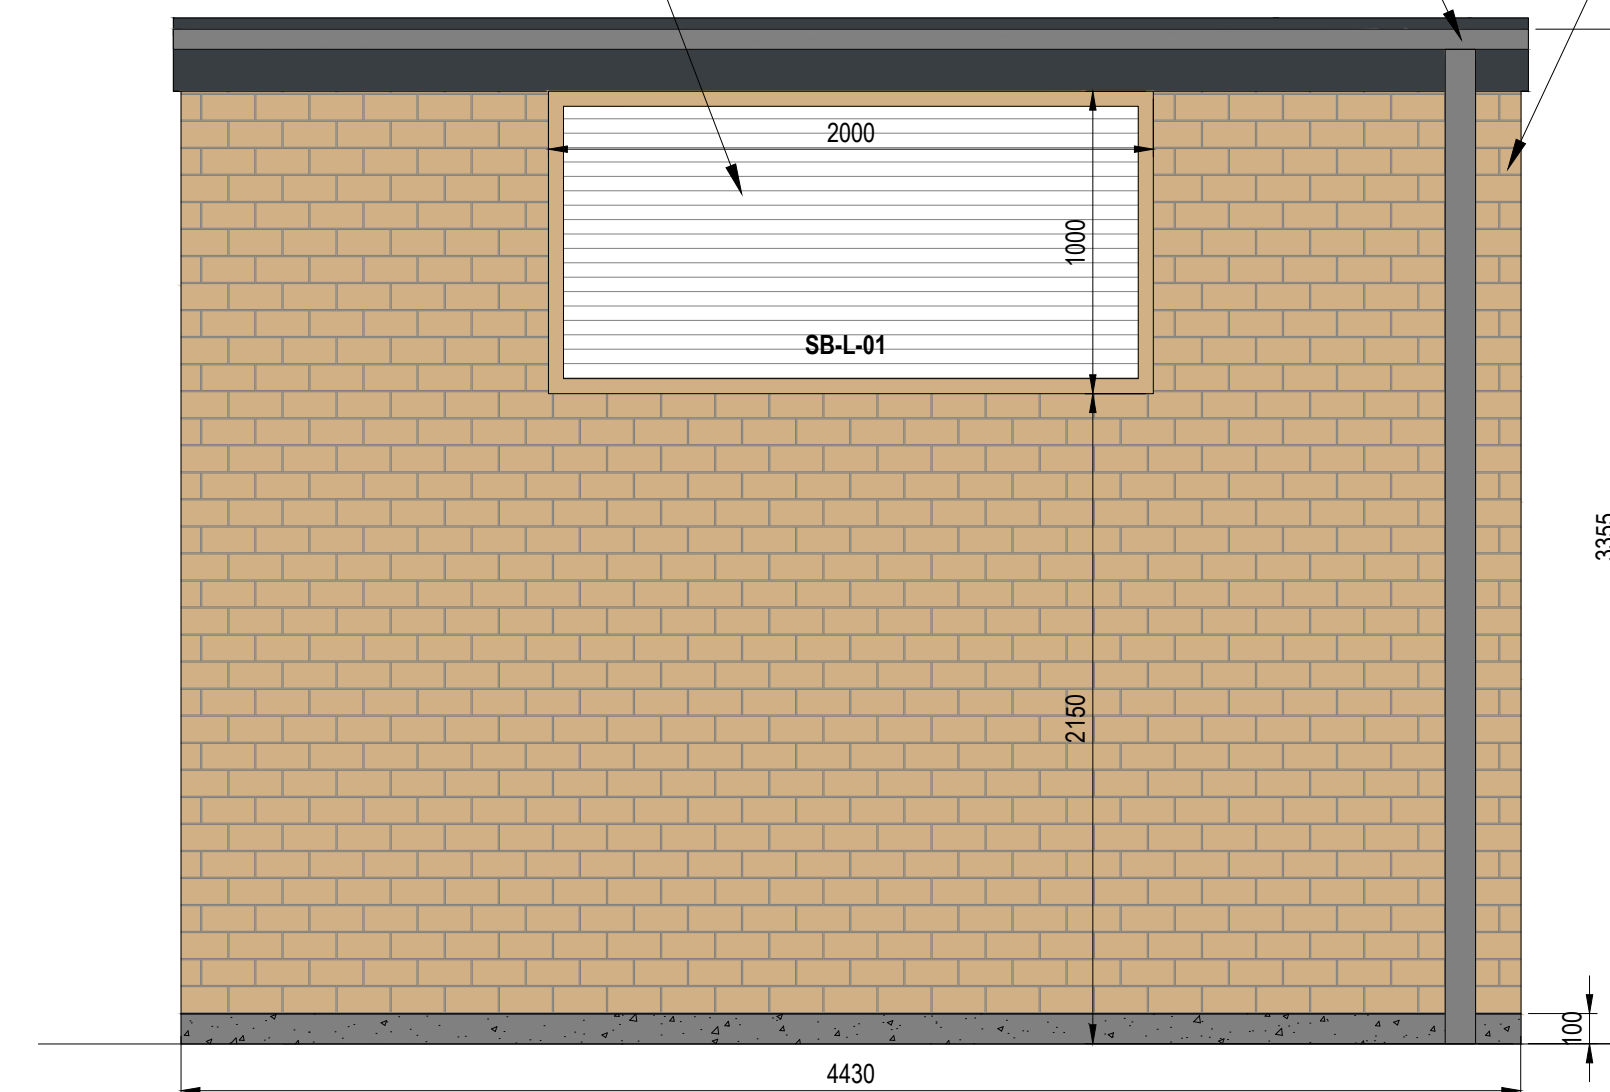

215mm FULLY BONDED BRICKWORK CONSTRUCTED IN ENGLISH BOND. INTERNAL LAYER TO BE PAINT GRADE BRICK. WALLS TO BE FINISHED WITH 2 LAYERS OF WHITE ANTI-MOULD EMULSION PAINT. WALLS TO ACHIEVE 4hr FIRE RESISTANCE. TO MATCH HOSPITALS EXISTING SURROUNDING BRICKWORK

100mm UPVC HALF ROUND GUTTER AND 100mm DIA. DOWNPIPE FIXED TO SUBSTATION FASCIA BOARD

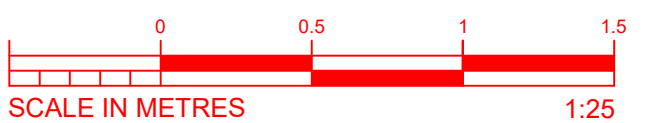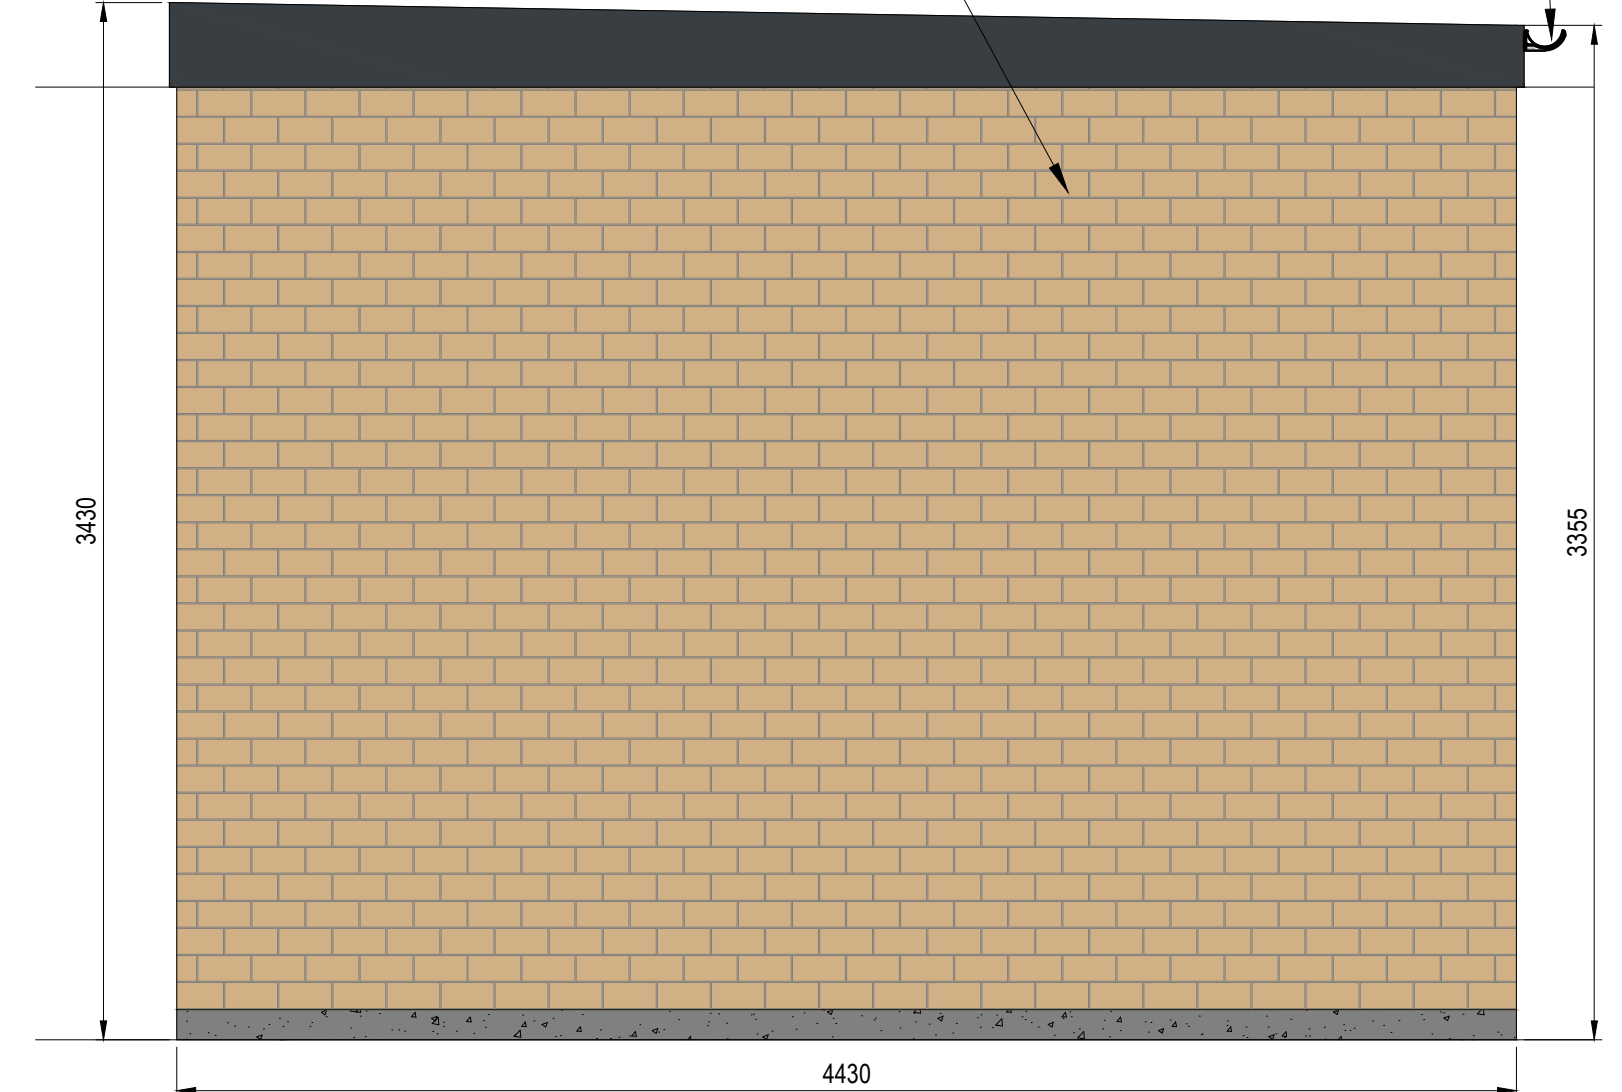

ISSUED FOR INFORMATION

P3	25-08-25	ISSUED FOR INFORMATION	GR	WE	RJR
P2	16-04-25	ISSUED FOR PLANNING APPROVAL	GR	CV	RJR
P1	18-03-25	ISSUED FOR PLANNING APPROVAL	GR	CV	RJR
REV	DATE	DESCRIPTION	DRW	CKD	APP

VITAL
ENERGI

Vital Energi, Century House, Roman Road, Blackburn, Lancashire, BB1 2LD
Tel: +44 (0)1254 296 000 Fax: +44 (0)1254 296 040

Project: WORTHING HOSPITAL ENERGY CENTRE				
Title: TRANSFORMER GA PLANS AND ELEVATIONS				
DATE	18-03-25	SCALE	1:25	SHEET
INFORMATION				A1
Status: S2				Stage: 4
50857-VE-SW-XX-E-A-6001				Rev: P3
Drg-No:				