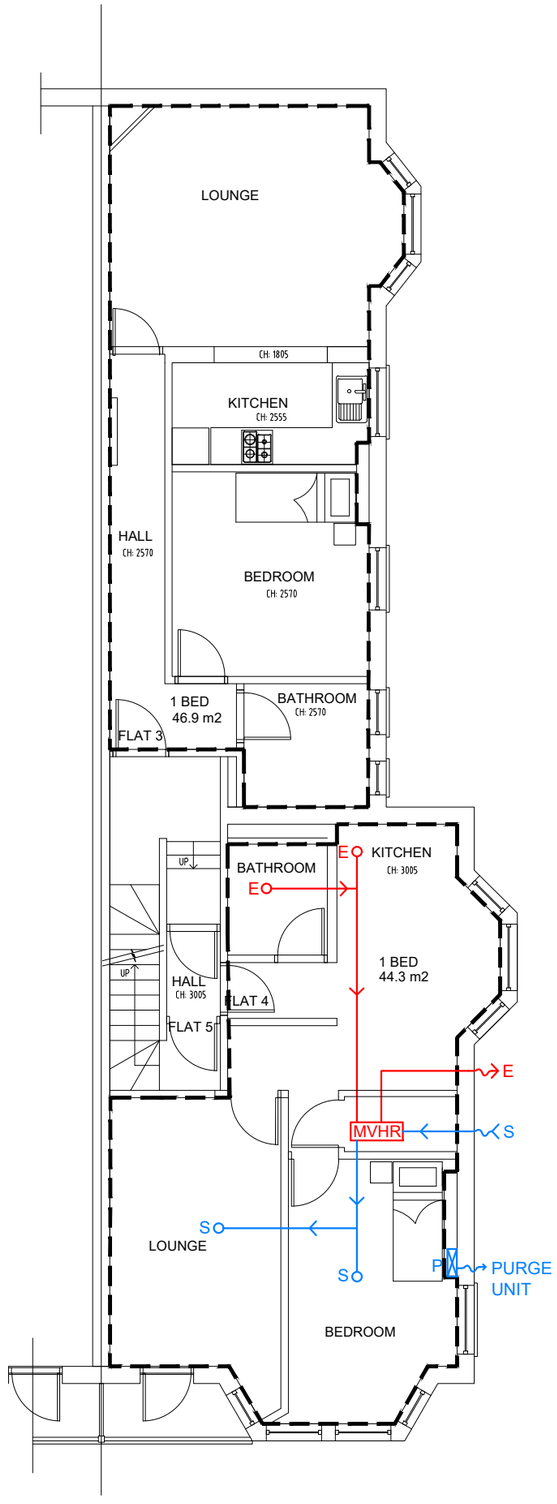



## MVHR

= MVHR UNIT

E = EXTRACT

S = SUPPLY

P = PURGE

MVHR SPECIFICATION:

Nuaire MRX Box95AB - WMI wall mounted unit with boost ventilation.

Supply + extract ducts to outside to be housed in acoustic attenuators.

PURGE UNIT SPECIFICATION:

Nuaire IAQ Purge
Unit - 3 speed
Exact handling to a maximum 200c/ sec.

GENERAL NOTES:

USE FIGURED DIMENSIONS ONLY.
DO NOT SCALE OFF DRAWINGS.
ALL DIMENSIONS ARE TO BE CHECKED ON SITE.
INCONSISTENCIES ARE TO BE REPORTED TO OATEN ARCHITECTS IMMEDIATELY.

COPYRIGHT OF OATEN ARCHITECTS LTD.

NOTES:

N

1:100

0 1 2 3 4 5 10

REV.: DATE: DESCRIPTION:

OATEN ARCHITECTS

Oaten Architects Ltd,
33 West Street, Hastings, East Sussex, TN34 3AN

T 01424 256476
E office@oatenarchitects.com
W www.oatenarchitects.com

PROJECT:
169 Brighton Rd, Worthing, West Sussex, BN11 2EU

STAGE: PL
SCALE: 1:100 @ A3
DRAWN BY - DATE: DS Nov 2025
CLIENT: -
CHECKED BY: RO

DRAWING TITLE:
1F MVHR/Purge Ventilation Proposal

DRAWING NO: 400
REV NO: _