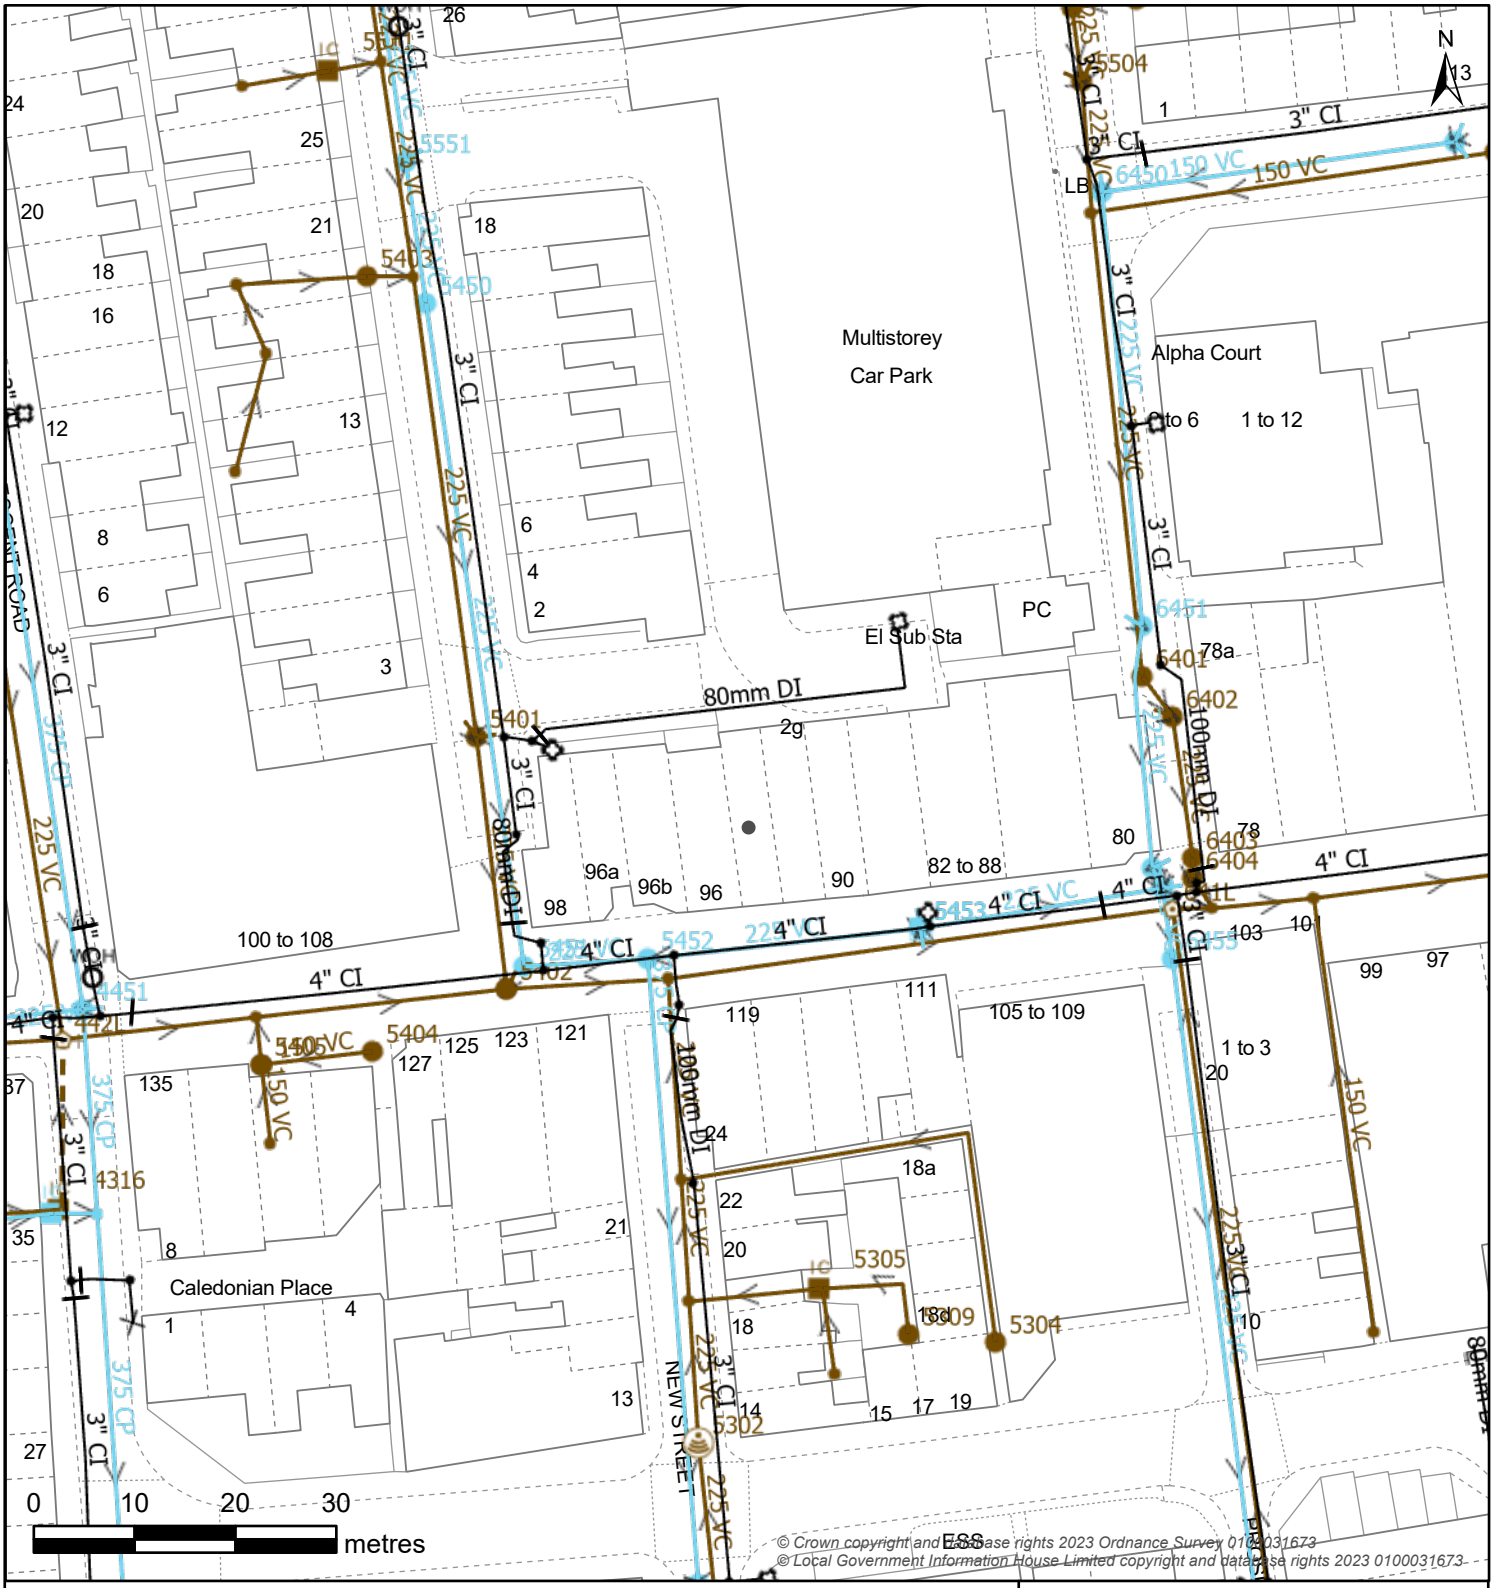

© Crown copyright and database rights 2023 Ordnance Survey 0100031673
© Local Government Information House Limited copyright and database rights 2023 0100031673

Boundary Box	Break Pressure Tank	Capped End	Hydrant
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug; Fire Hydrant; WOH Washout Hydrant

Pressure Monitoring	Service Reservoir	Meter	Valve - Controllable
Logger	Covered; Tower	Meter	Open Valve; Closed Valve; Stop Tap

Site	Valve - Flow
Abstraction Point; Supply Works; Booster Station; Transfer Station; Surface Reservoir; Underground Source	AV Air Valve; NRV Non-Return Valve; WO Washout Empty Valve

Valve - Pressure	Pipe Bridge
PRV Pressure Reducing Valve; PSV Pressure Sustaining Valve	Pipe Bridge

Water Pipe	Water Area
Communication; Trunk; Decommissioned; Distribution; Raw; Discolouration; Non-Potable; Private	Water Supply Zone; District Meter Area

Map Title: SW Print

Printed By: Sachin.Lamani

Date Printed: 25/01/2024

Map Scale: 750

The positions of pipes on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on-site

WATER for LIFE from Southern Water