
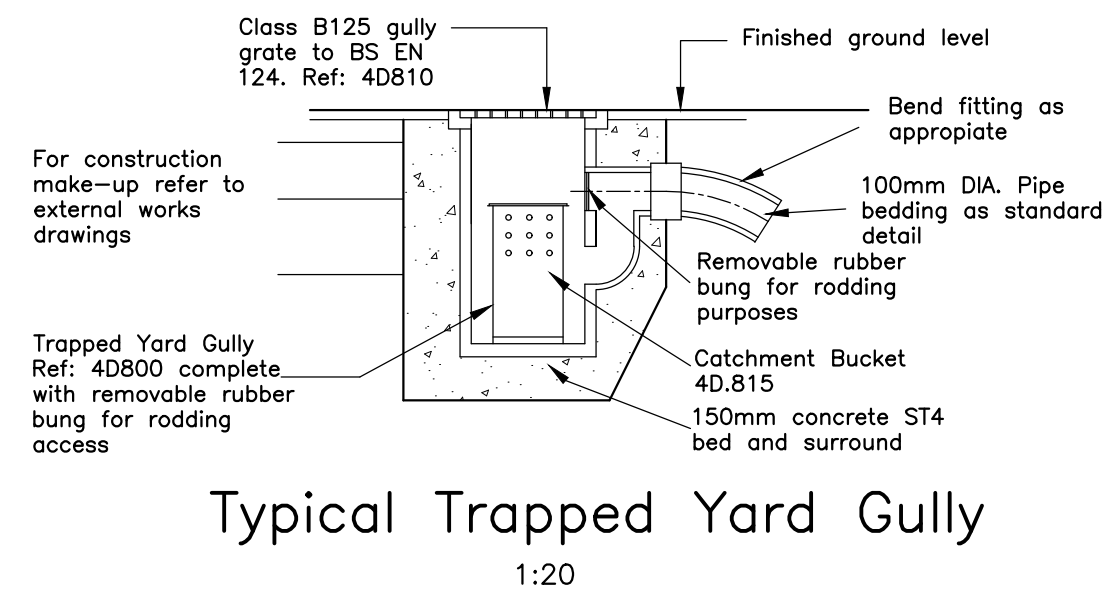
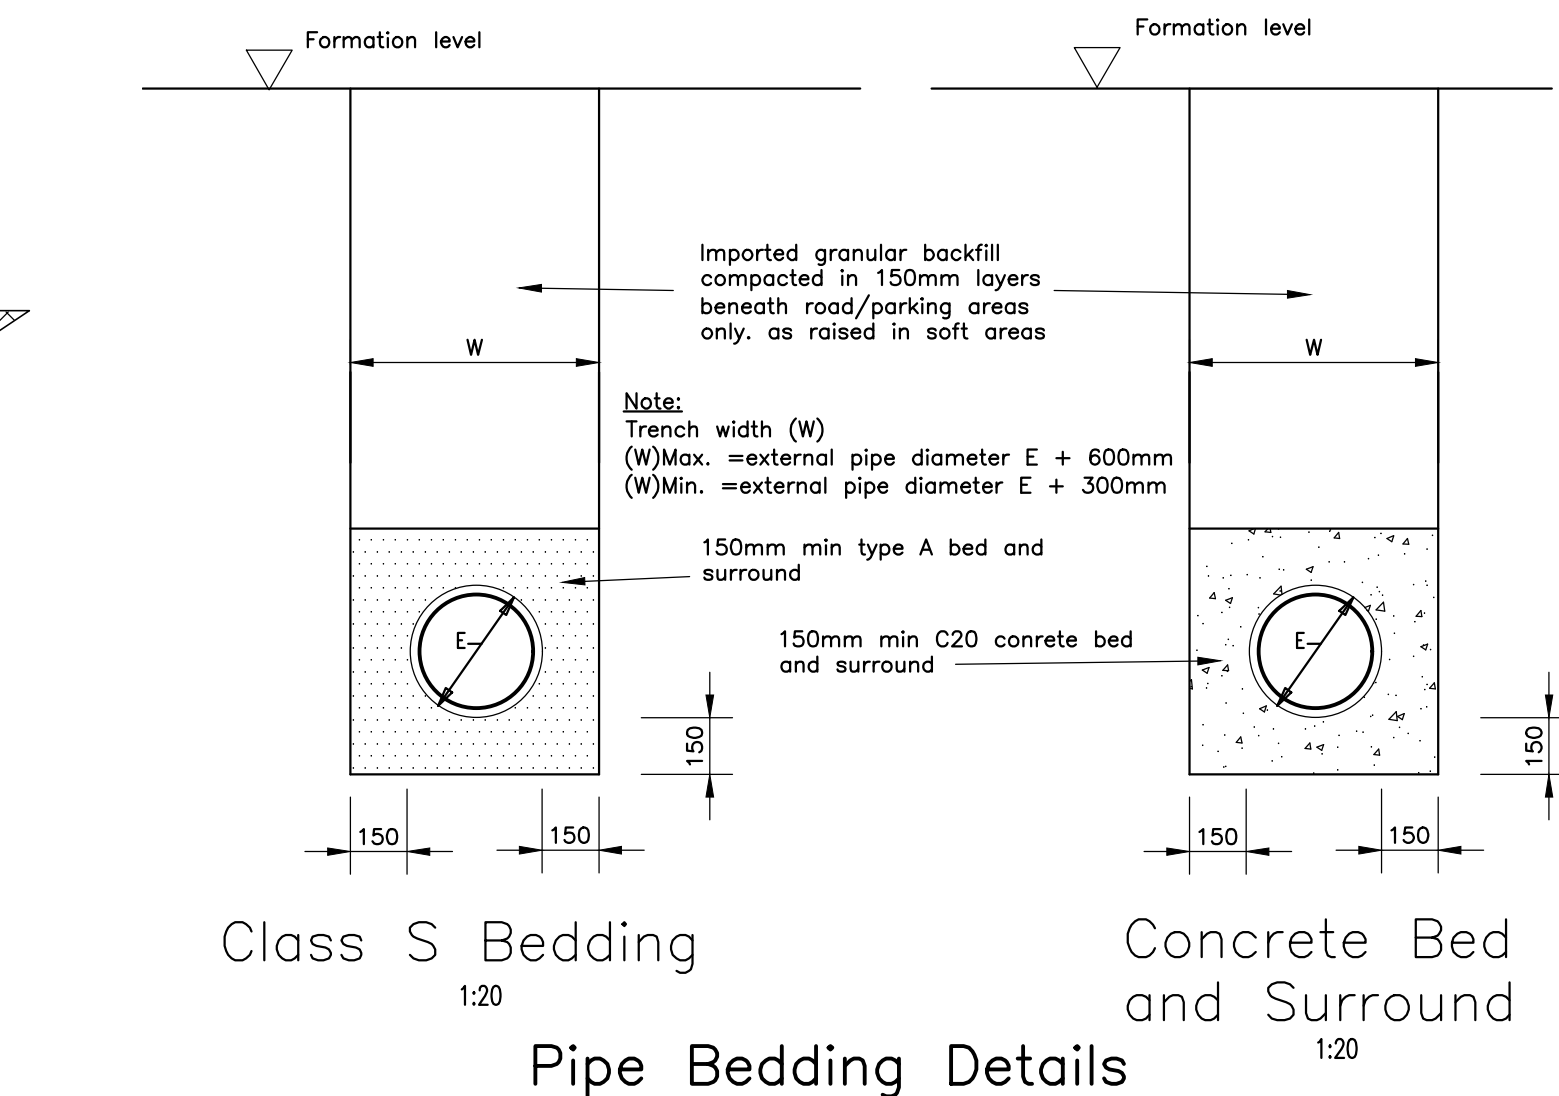
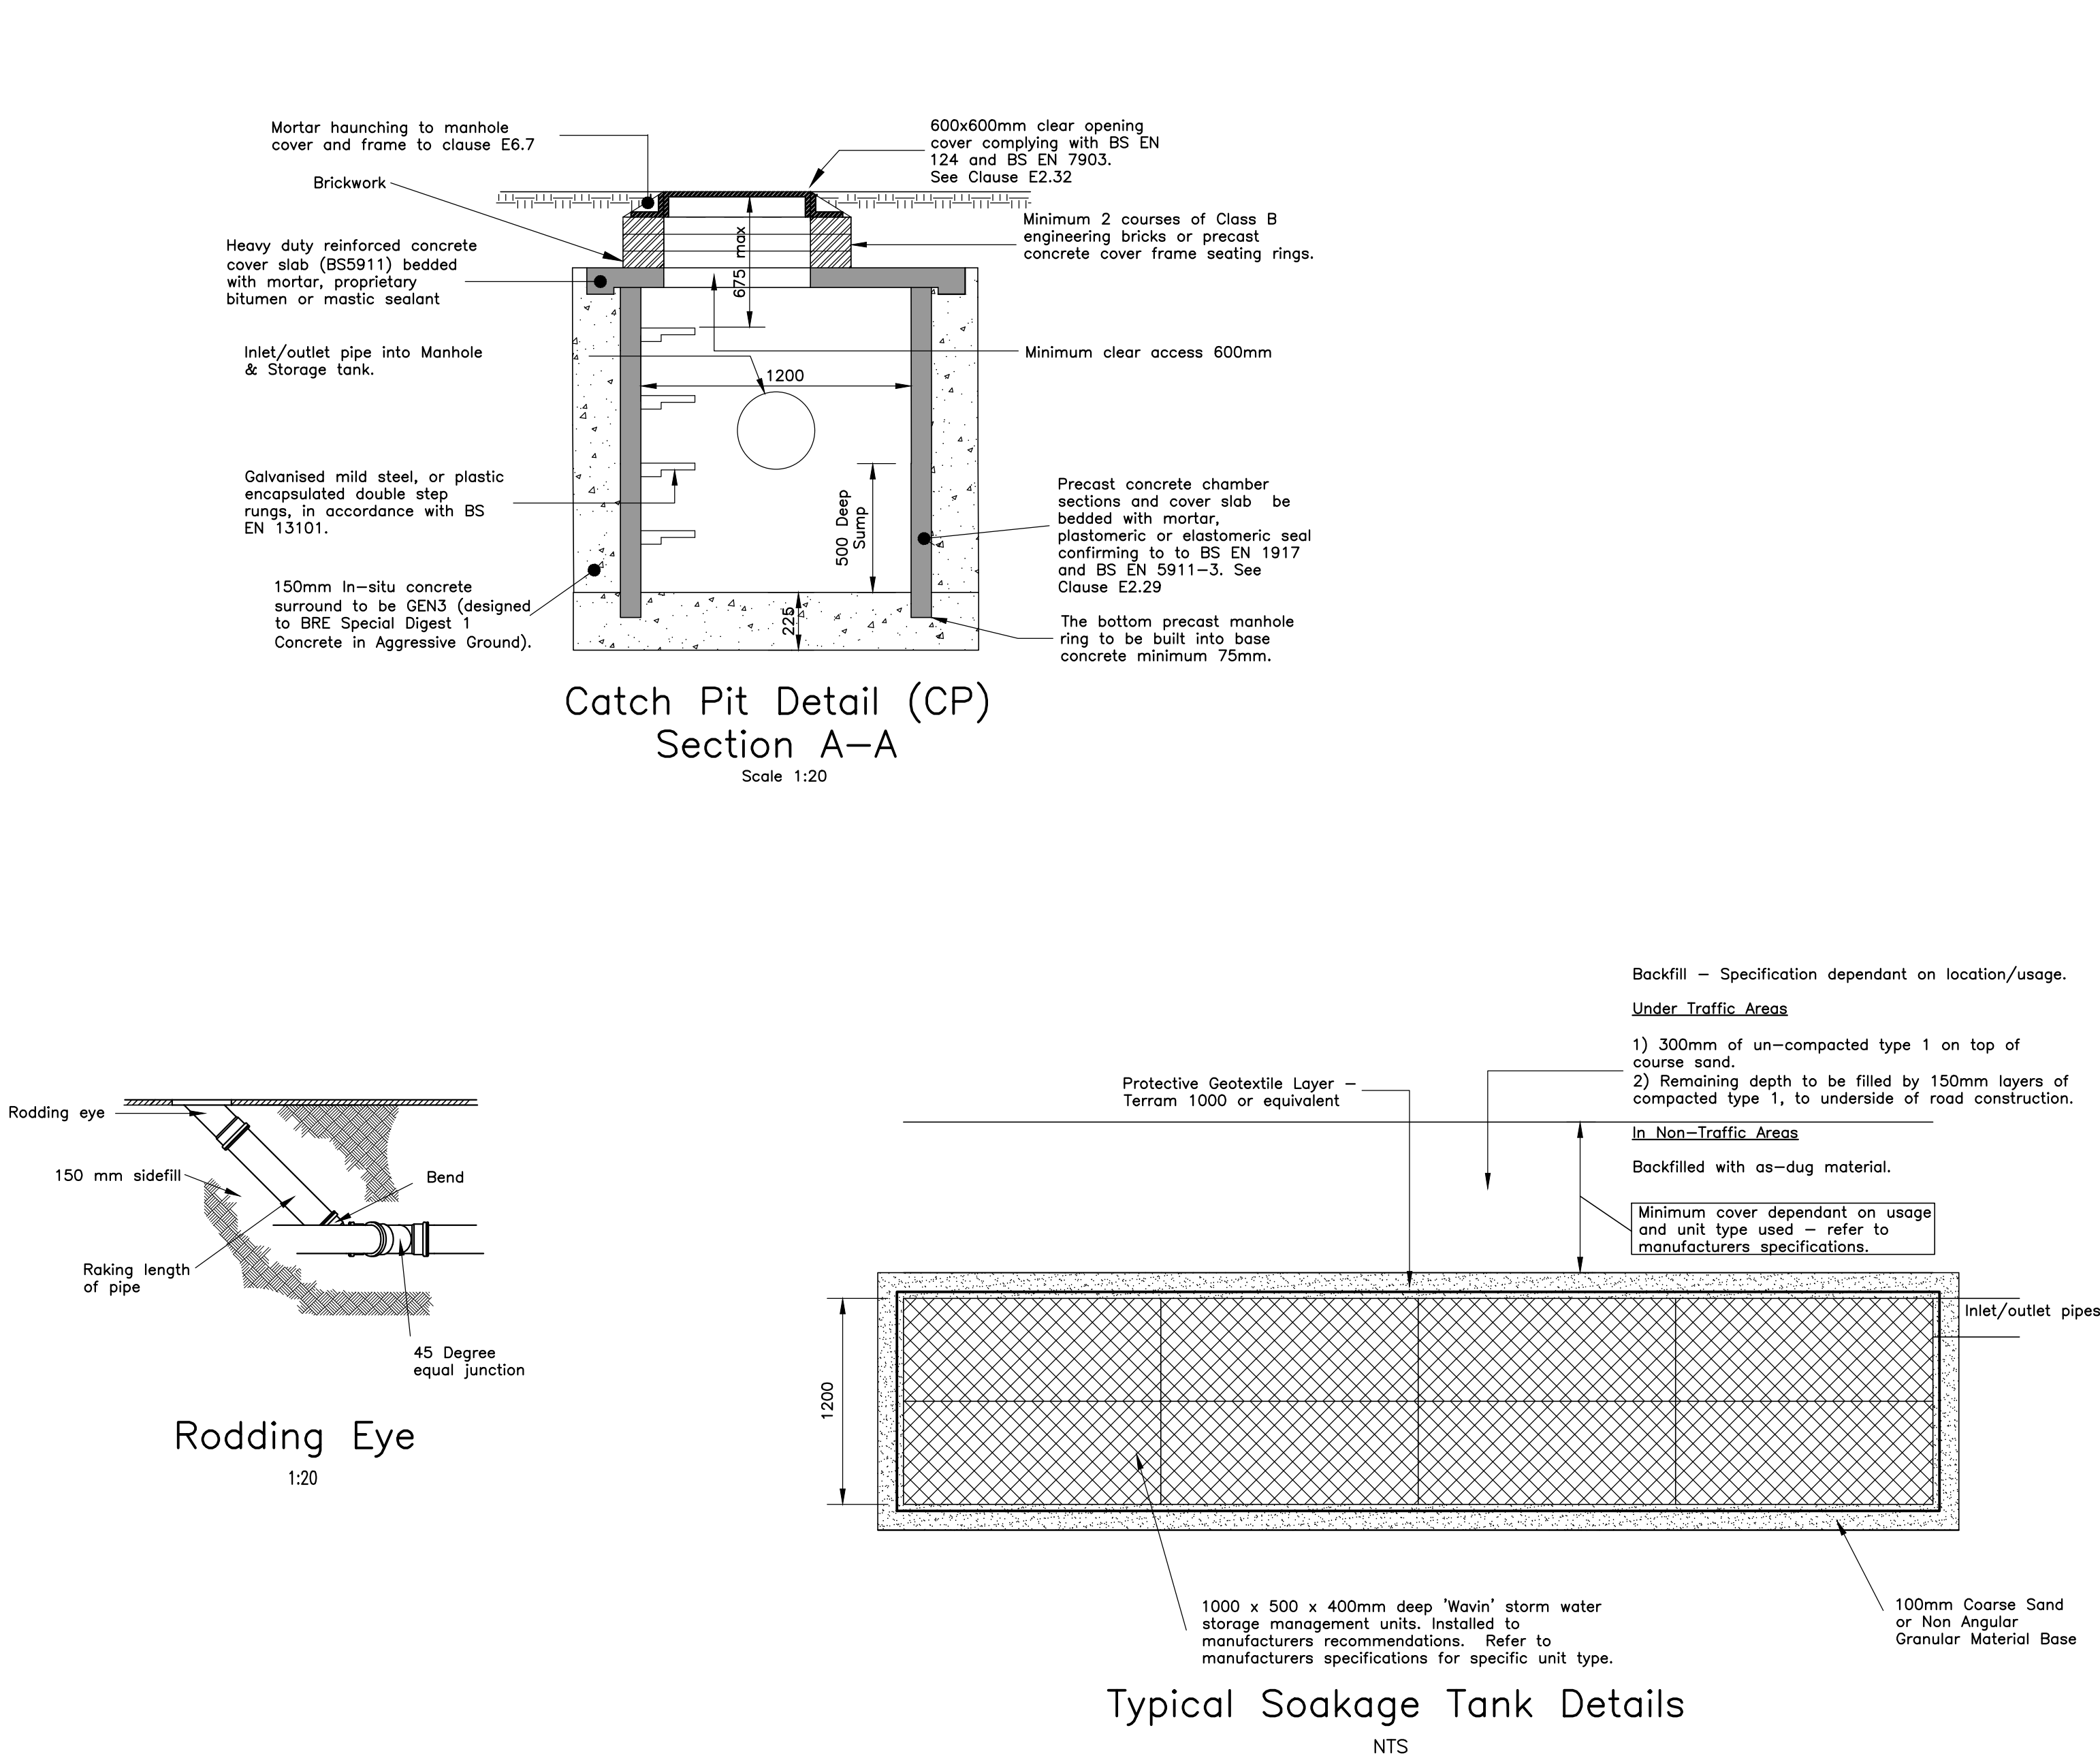
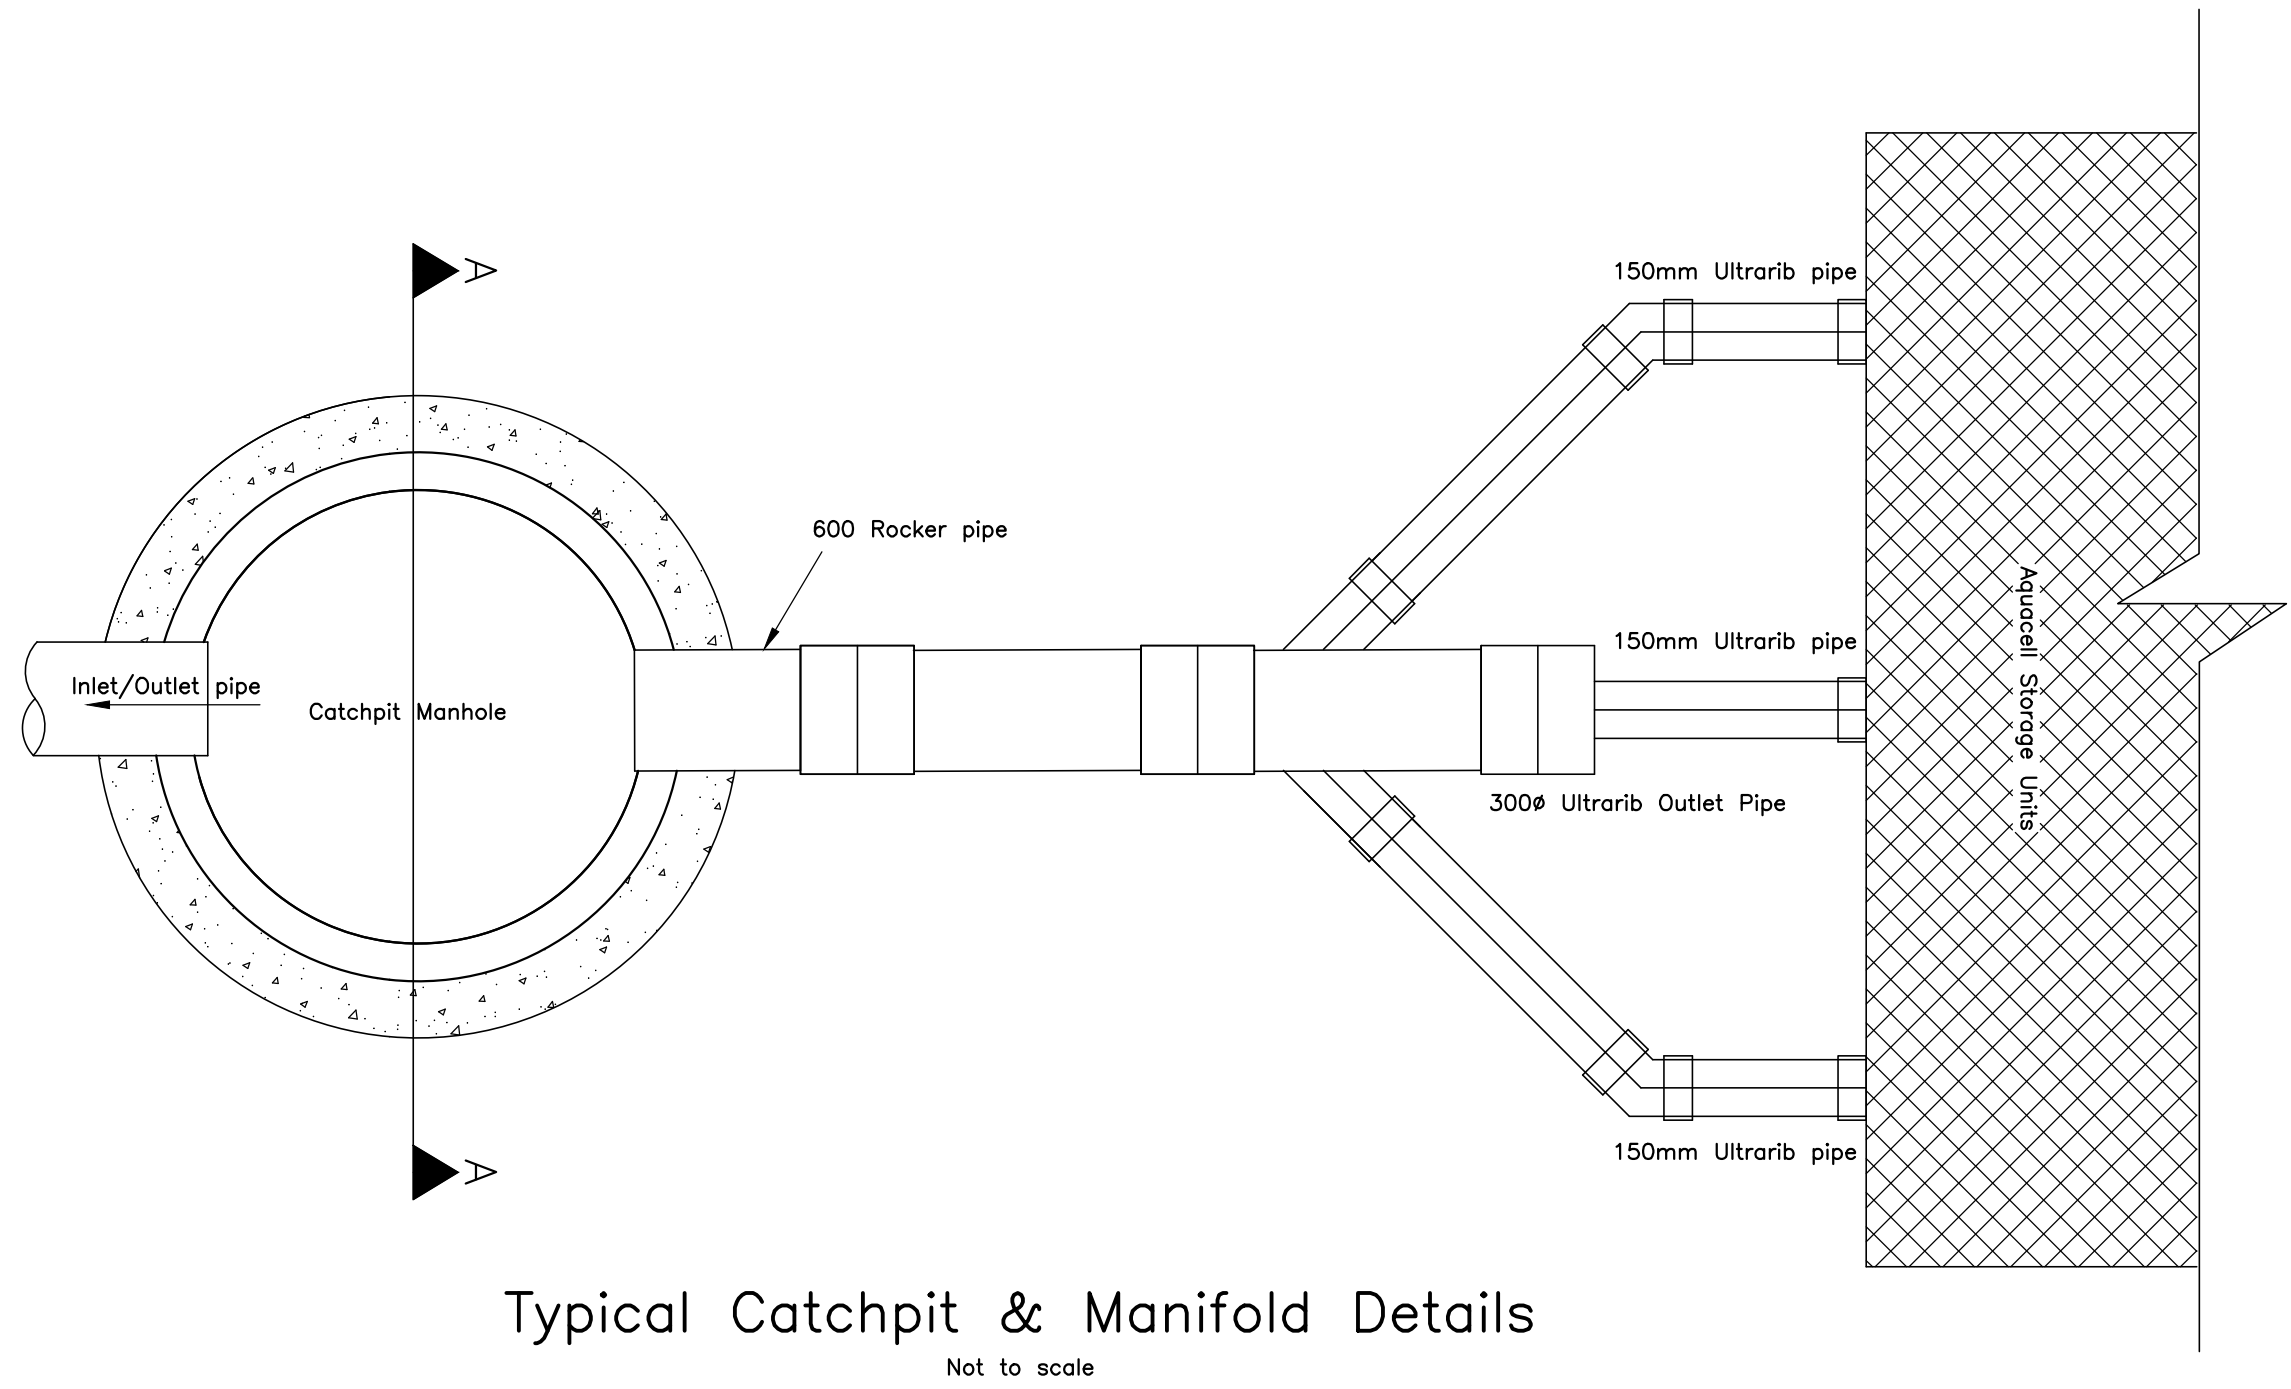


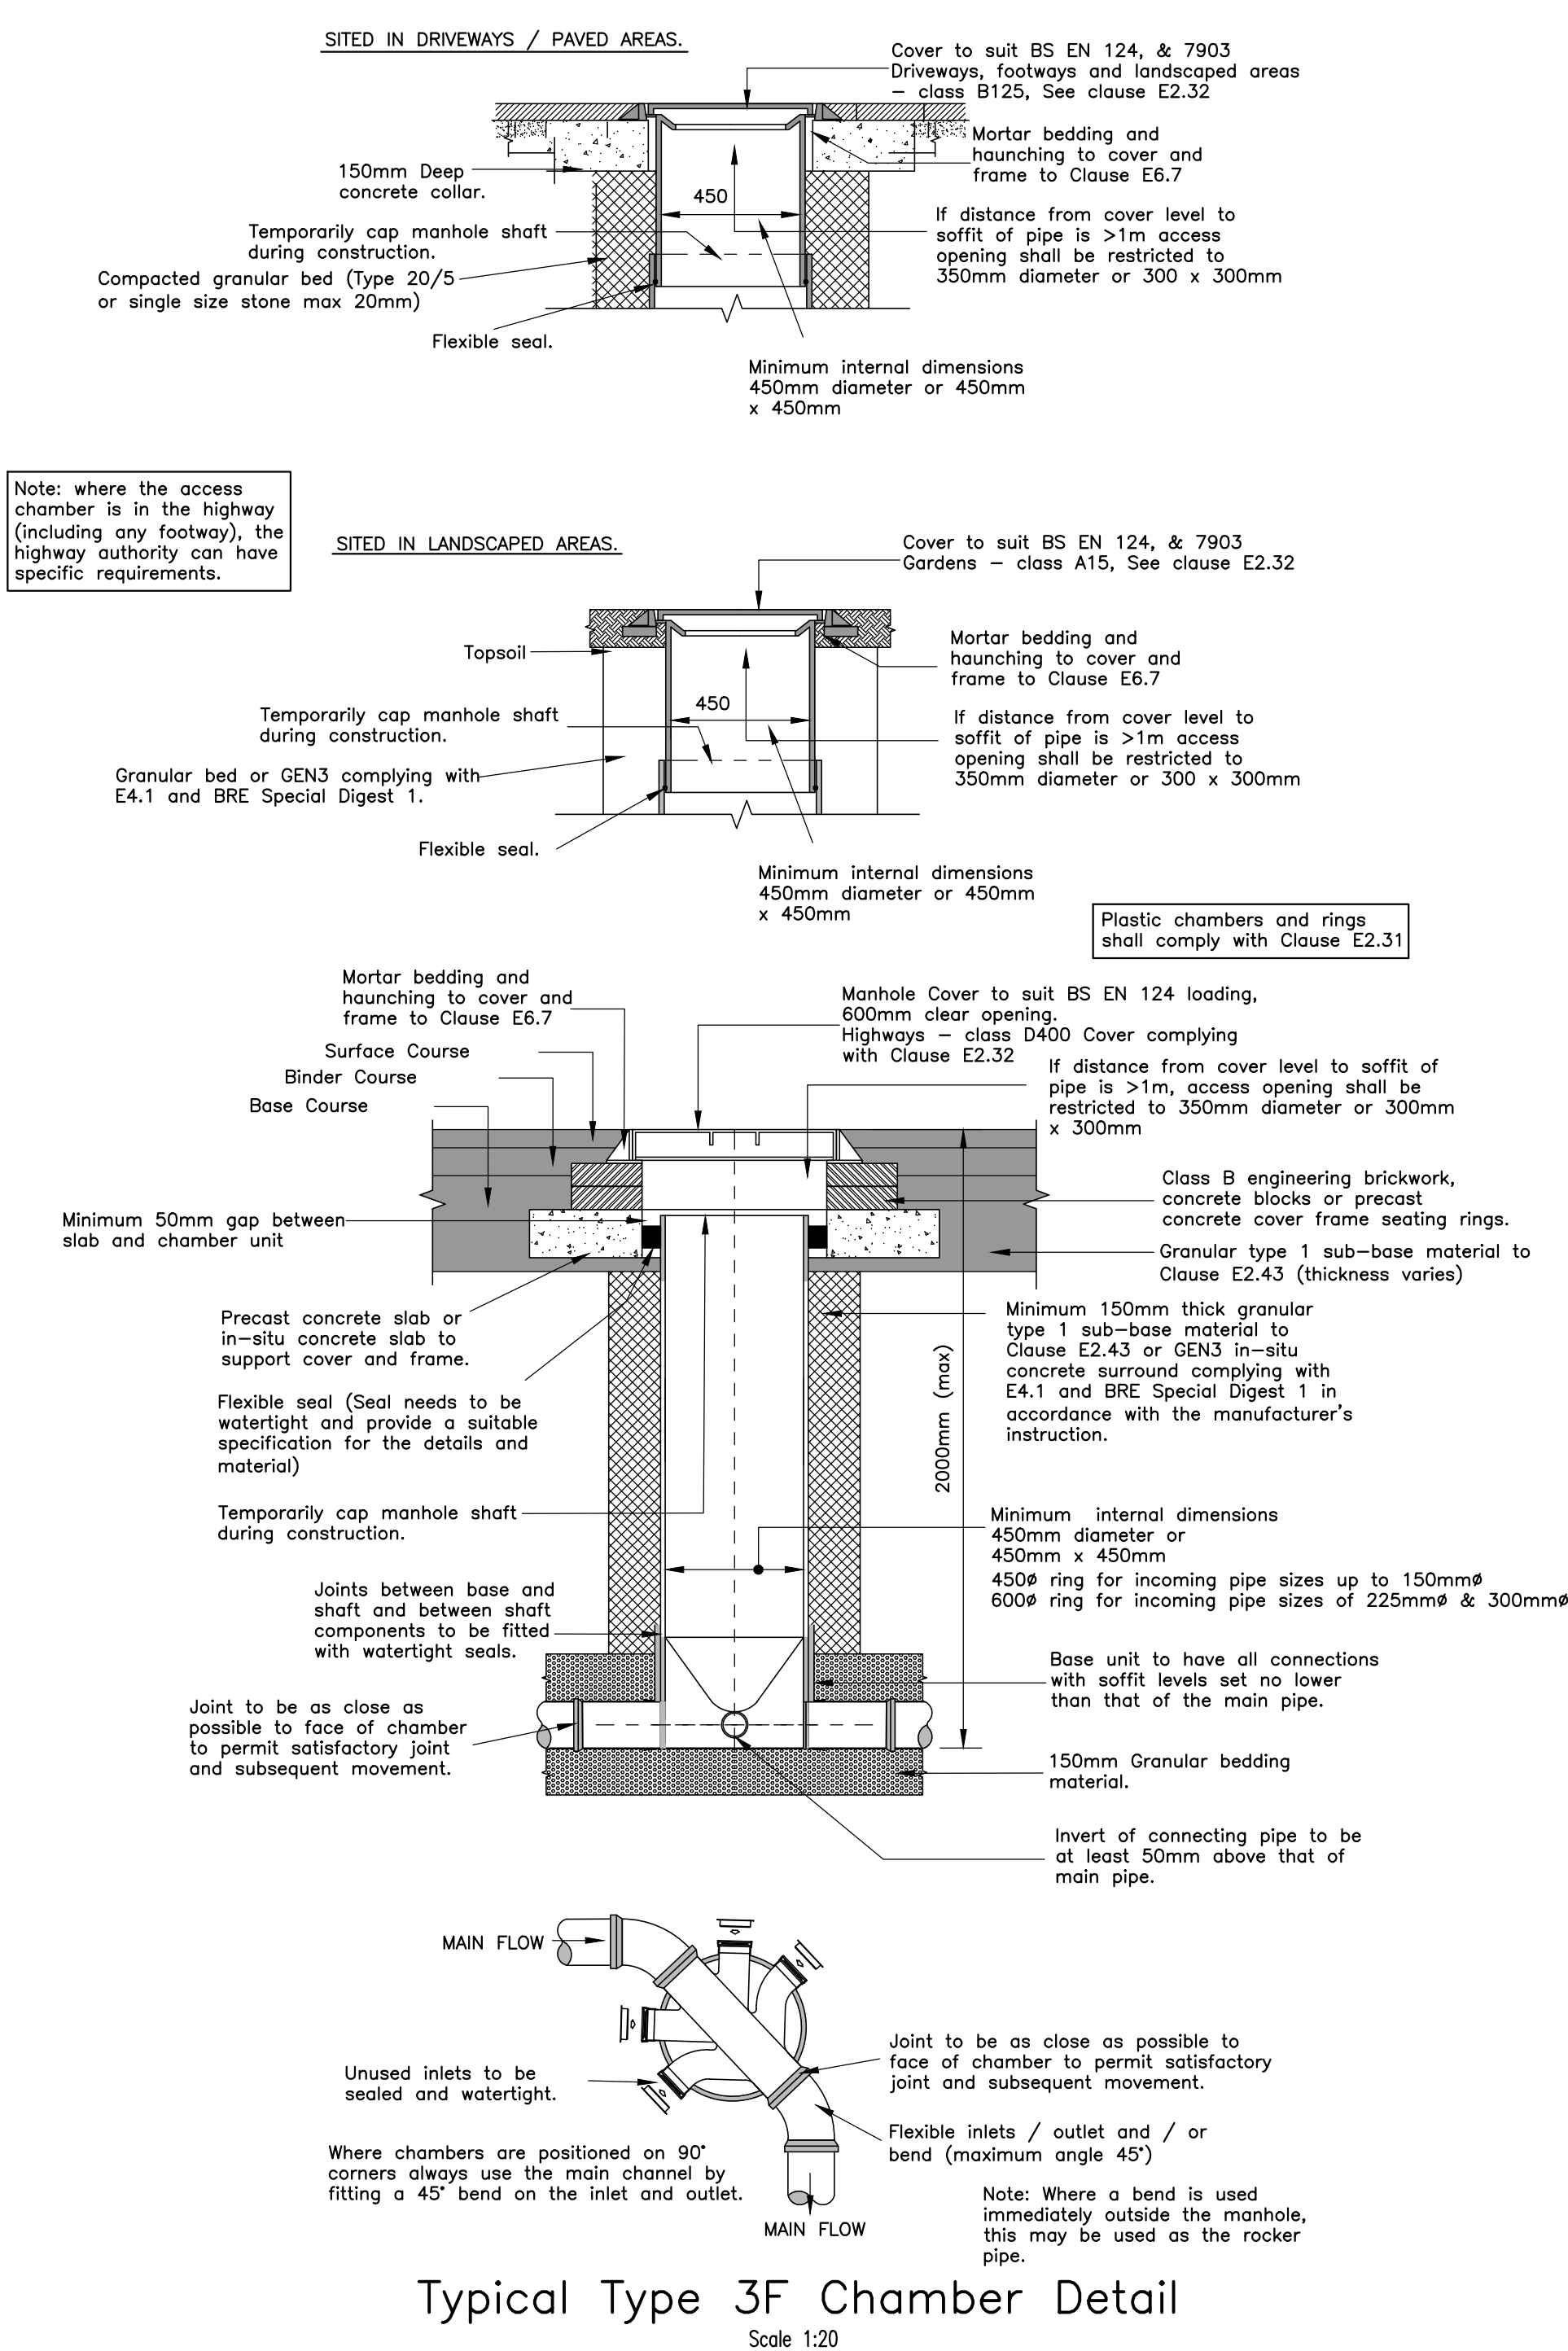

Notes:

- This drawing shall be read in conjunction with all relevant engineers drawings. Any discrepancies found between information shown on this or any other drawing shall be reported to the Walker Associates' engineer immediately and prior to any works commencing on site.
- All adoptable drainage works shall be undertaken strictly in accordance with the Design and Construction Guidance DCG.
- Type A granular bedding shall consist of 14mm single sized pea shingle to TABLE 1 of BS 882 part 2 1973.
- Selected fill type B shall consist of uniform readily compactable material free from tree roots, vegetable matter, building rubbish and frozen soil and excluding clay lumps retained on a 75mm sieve and stones larger than the maximum size permitted on any adjacent type a bedding material.
- Where concrete bed and surround is specified joint filler should be provided at every joint. The filler may be expanded polystyrene 25mm thick or flexcell cut to the shape of the bed and surround and such that the ingress of concrete into the pipe is prevented.
- To allow for possible differential movement a flexible joint must be incorporated in each section of pipeline within 150mm of where it enters a building or connects with a manhole, wall or other structure:– see manufacturers instructions
- All pipework generally to be bedded as follows
 - Under vehicular areas where cover is less than 900mm under pedestrian areas where cover is less than 600mm
 - Under vehicular areas, pedestrian areas where depths given in (i) are exceeded;
- All private pipework shall be either vitrified clay, concrete or UPVC to BS 65, 5911 and BS EN 1401 respectively
- All private drainage beneath adoptable carriageway shall be vitrified clay extra strength and with concrete bed and surround should cover depth be less than 1.2m.
- All concrete at or below ground level on site shall be able to withstand class 2 sulphate concentrations in accordance with BRE digest 363

C1	TYPE B AND E CHAMBER DETAILS REMOVED	18.07.25
P2	UPDATED TO P2 REVISION	18.07.25
P1	PRELIMINARY ISSUE	18.07.25
REV	REVISIONS	DATE

PROJECT
**KINGSTON LANE
SHOREHAM-ON-SEA**

TITLE
**PRIVATE DRAINAGE CONSTRUCTION
DETAILS**

CLIENT


M. PEGRAM & ASSOCIATES LTD
BUILDING DESIGN CONSULTANTS
CIVIL & STRUCTURAL ENGINEERS
12-13 Thames Street
Sunbury-on-Thames
Middlesex TW16 5QP
Tel: 01932 779787
e-mail: mike@mpegram.co.uk
Web: www.mpegram.co.uk

DRAWN LK	SCALE 1:20	JOB NO @A1 2512
CHECKED LW	DATE JUN 25	DRG NO 501
		REV C1

CLIENT REF NUMBER
1265-MPA-XX-XX-DR-C-2512_501